


PRESSURISED SYSTEM SHOWING CONNECTION TO BACK-UP OIL OR GAS BOILER

Note: the expansion vessel must be a minimum of 10% of whole system volume. If in doubt 20-25% of Accumulator size and check pressure set in the expansion vessel.



sheet4amended

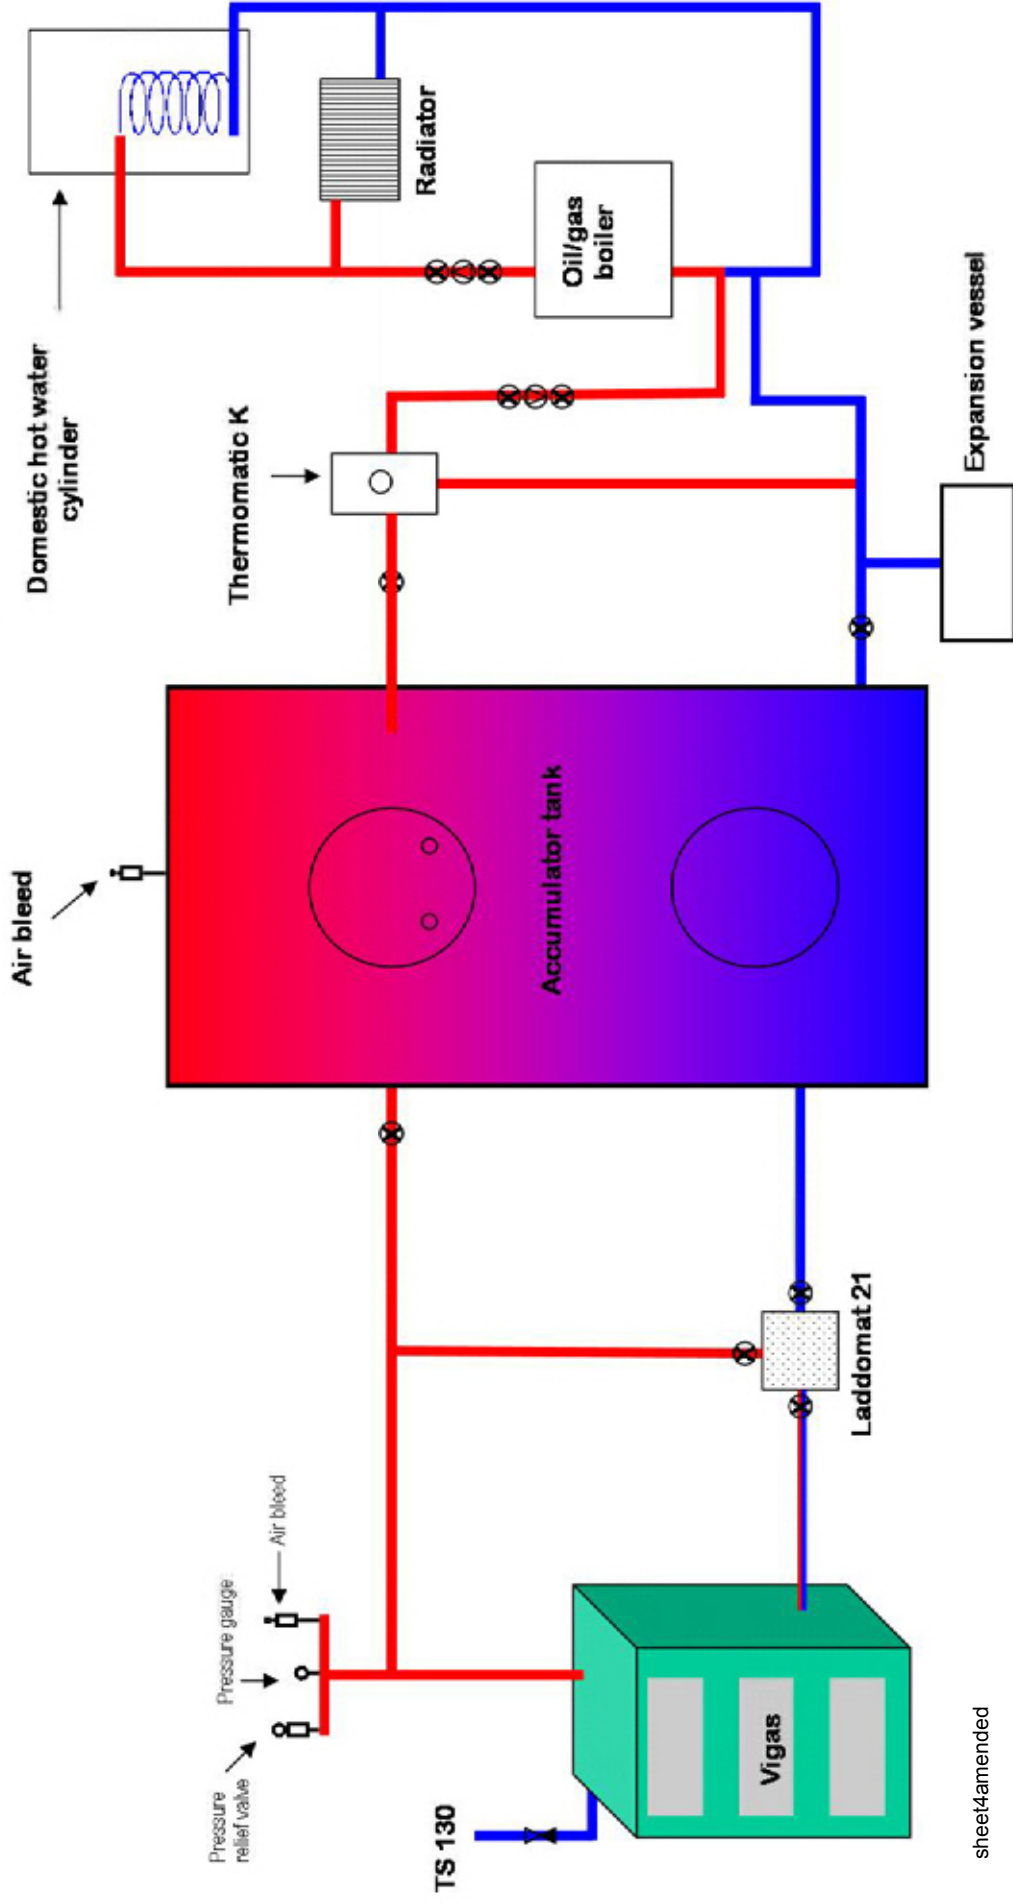

Dunster Heat Limited,
Higher Court, Treborough, Taunton, Somerset TA3 0QW

w www.dunsterheat.co.uk

t 01984 640656 **e** info@dunsterheat.co.uk